


ACOUSTIC TEST



Compact Homogeneous Vinyl Normalized Impact Sound Pressure Levels Bare Slab and Regupol 4515-S 3mm Acoustic Underlay

Lab Test: CSIRO INR210-08-02 – Test Sample
Test Date: 20/05/2016
Construction: Bare 150mm Concrete Slab
 Layer of 2mm Compact Homogeneous Vinyl, to Regupol® 4515-S 3mm, to 150mm Concrete Slab

* Sample was dual bonded. Sample size 3600mm x 3000mm (10.8m²)

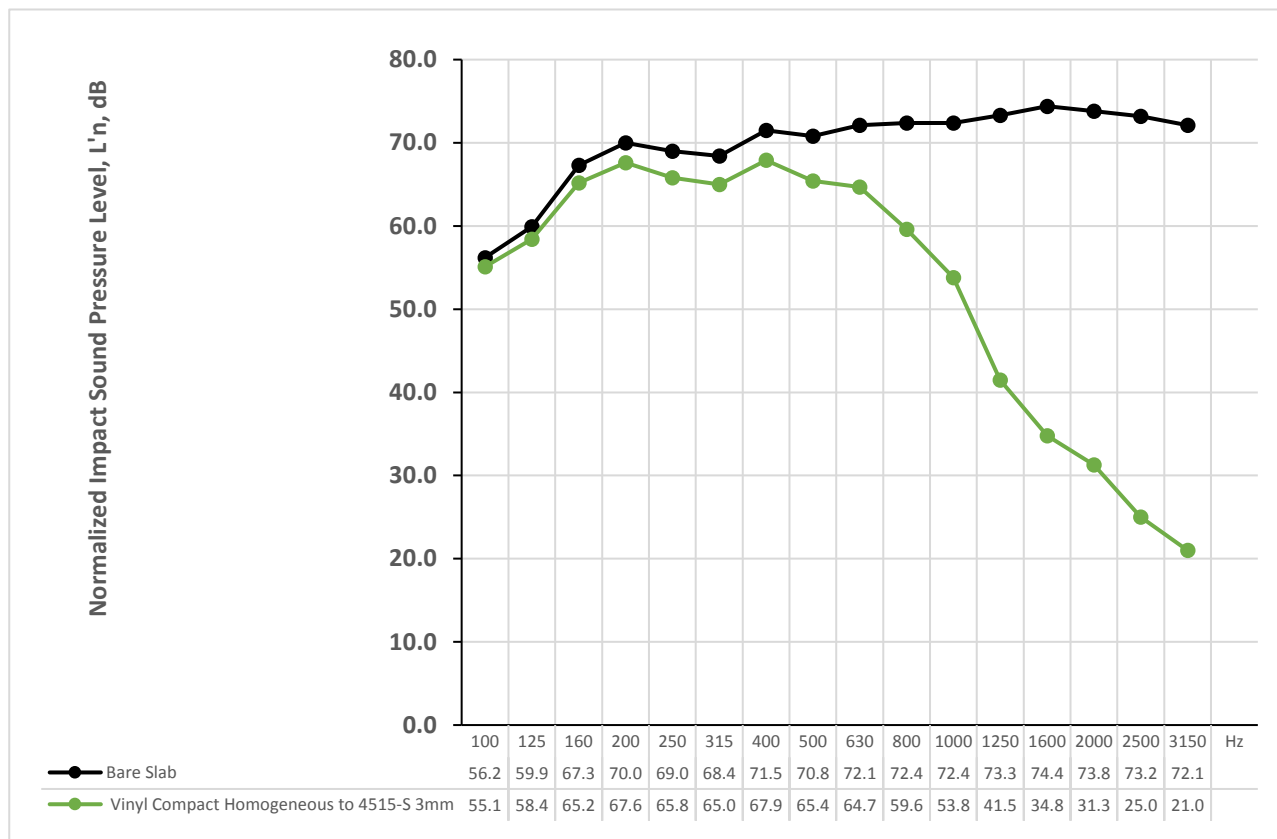

Results	Improvement	IIC	BCA Compliance	AAAC Star Rating
Bare 150mm Concrete Slab				
Layer of Compact Homogeneous Vinyl, to Regupol® 4515-S 3mm, to 150mm Concrete Slab				
$L_{n,w}(C_i) = 61 (-1) \text{ dB}$	Improvement $\Delta 17\text{dB}$	IIC 49	Yes	2 Star

Disclaimer

This Acoustic Test is provided "as is" without any representations or guarantees, express or implied. Regupol (Australia) Pty Ltd ("Regupol") makes no representations or guarantees in relation to this Acoustic Test or the information and materials provided herein. The information and data collected herein are based on industry accepted testing methods. It is intended as descriptive of the performance characteristics and capabilities of Regupol® acoustic underlays and does not certify applicability for any particular or specific project. Although we make a reasonable effort to include accurate and up to date information, without prejudice to the generality of this paragraph, Regupol does not guarantee or warrant that the information in this Acoustic Test is complete, true, accurate or non-misleading. This Acoustic Test is provided solely for informational purposes. You should not act upon information without consulting Regupol, a subsidiary or an appropriate professional Acoustical Consultant.

