

**ATTAR TEST REPORT NUMBER: 14/8106.4**

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025.
Accreditation Number: 2735

11 August 2014

Total Pages: 2**WET PENDULUM SLIP RESISTANCE**

Job No: M14/8106

| | | | | | | |
|---|---|----------|----------|----------|----------|------------|
| Prepared for: | Tarkett Australia Pty Ltd 16 Anella Avenue CASTLE HILL NSW 2154 | | | | | |
| Attention: | Maria Barreto-Tilman | | | | | |
| Test Site: | Test Slip Australia Pty Ltd, Beaumont Hills, NSW. | | | | | |
| Test Date: | 4 August 2014 | | | | | |
| Test Specimens, Size & Quantity: | iQ Optima sheet vinyl, 300mm x 300mm, 5 off. | | | | | |
| Sampling & Direction of Testing: | Sampling conducted by client. Tested parallel with the direction of manufacture. Refer to Figure 1. | | | | | |
| Test Personnel: | Clark Ahearn | | | | | |
| Preparation: | Washed with water and pH neutral detergent, rinsed with water, then dried. | | | | | |
| Fixed/Unfixed: | Fixed. | | | | | |
| Air Temperature: | 20°C | | | | | |
| Test Equipment: | Wessex Skid Resistance Tester (Pendulum) Serial Number SK 1818, Calibrated 29/07/2014. | | | | | |
| Test Standard: | AS 4586: 2013 Slip resistance classification of new pedestrian surface materials – Appendix A. | | | | | |
| Slider Rubber: | Slider 96 Batch No. #53 prepared on P400 & 3µm lapping film. | | | | | |
| Classification Criteria: | Refer to Classification Criteria, attached as Appendix 1. | | | | | |
| British Pendulum Number | Specimen Number | | | | | SRV |
| | 1 | 2 | 3 | 4 | 5 | |
| | 44 | 44 | 44 | 45 | 46 | 45 |
| Classification: | P4 | | | | | |

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

NOTE: Any specimens supplied will be disposed of in two (2) months time, unless otherwise instructed.

ATTAR

Marcus Braché
Senior Engineering Technician
Approved Signatory

This report may not be reproduced except in its entirety.

ATTAR TEST REPORT NUMBER: 14/8106.4

11 August 2014

Total Pages: 2

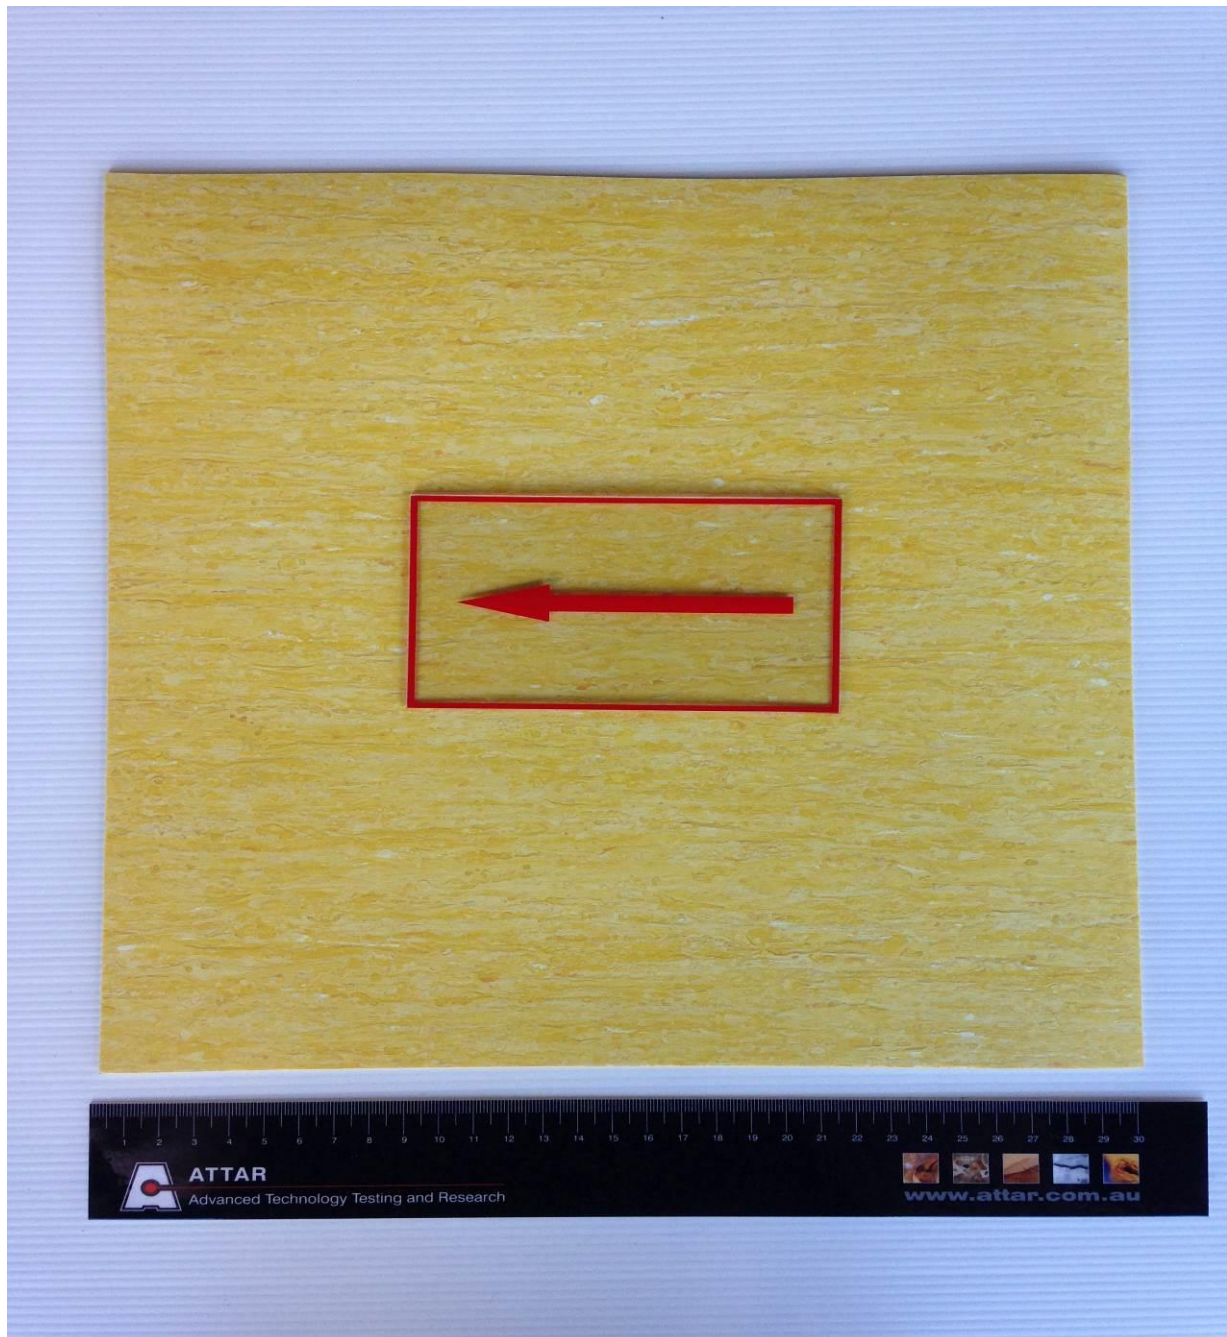


Figure 1: iQ Optima – Highlighted area indicates area tested and direction of test.

This report may not be reproduced except in its entirety.